

Weekly Water Report	As of: April 18, 2023	As of: April 25, 2023	
New Hogan (NHG) TOC	234,558	238,004	AF
Storage:	234,308	237,895	AF
Net Storage Change:	+5,465	+3,587	AF
Inflow:	378	304	CFS
Release:	22	80	CFS
New Melones (NML) Allocation	75,000	75,000	AF
Storage:	1,448,961	1,483,786	AF
Net Storage change:	+29,470	+34,825	AF
Inflow:	4,400	4,621	CFS
Release:	1,733	1,908	CFS
Source: CDEC Daily Reports			


Goodwin Diversion (GDW)			
Inflow (Tulloch Dam):	1,768	1,925	CFS
Release to Stanislaus River (S-98):	341	1,503	CFS
Release to OID (JT Main):	475	733	CFS
Release to SSJID (SO Main):	102	257	CFS
Release to SEWD:	<u>50</u>	<u>61</u>	CFS
Total Release	968	2,554	CFS
Source: Tri-Dam Operations Daily Report			
Farmington Dam (FRM)			
Diverted to SEWD:	N/A	N/A	CFS
Diverted to CSJWCD:	0	0	CFS
Source: USACE WCDS Hourly Report			

Surface Water Used			
Irrigators on New Hogan:	0	2	
Irrigators on New Melones:	0	0	
Out-Of-District Irrigators:	0	0	
DJWWTP Production:	22	26	MGD
North Stockton:	0	0	MGD
South Stockton:	3	6	MGD
Cal Water:	24	24	MGD
City of Stockton DWSP Production:	13	13	MGD

District Ground Water Extraction			
74-01	0	0	GPM
74-02	0	0	GPM
North	0	0	GPM
South	0	0	GPM
Extraction Well # 1	<u>0</u>	<u>0</u>	GPM
Total Well Water Extraction	0	0	GPM
Total Ground Water Production	0	0	MGD

Note: All flow data reported here is preliminary, as of 10:30 a.m. on 04/25/23.

STOCKTON EAST WATER DISTRICT

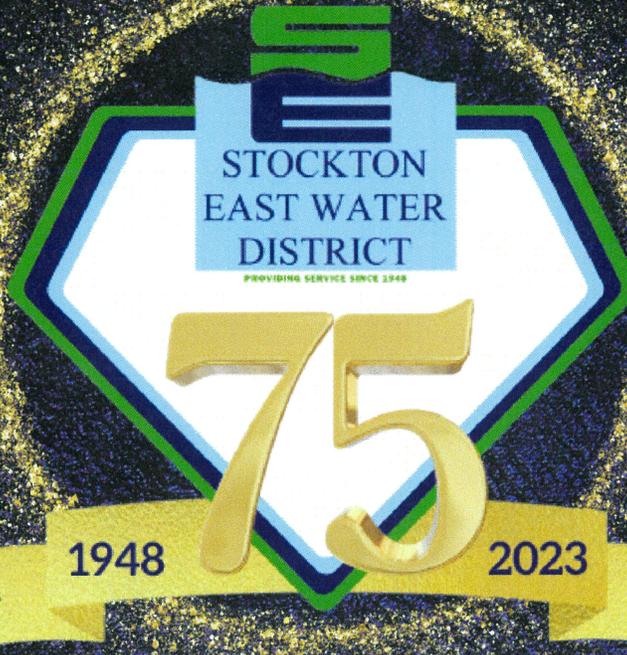


Anniversary

75 years have come and gone and with it all of the excitement, hardships, and little victories that make life, and business, worthwhile. At this time, we wanted to let our most valued customers know just how much we appreciate their continued patronage. We couldn't have made it through another year without you. So, Join us in celebrating 75 years of service with food, music, raffle prizes and a tour of the treatment plant.

Friday
June 9
At 10AM - 3 PM 

RSVP

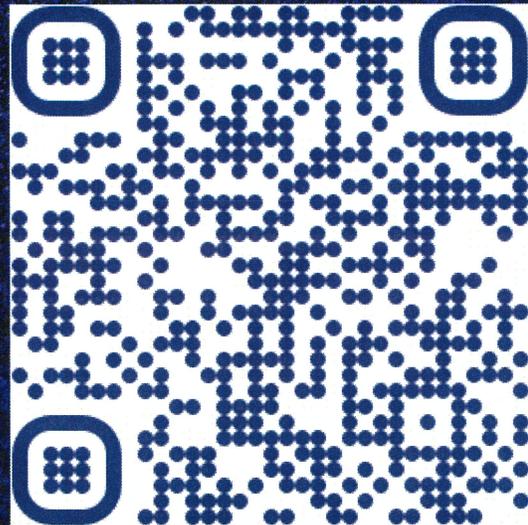

*Do you know where your water
comes from?*

STOCKTON EAST WATER DISTRICT

The Stockton East Water District was formed in 1948 and is responsible for providing supplemental surface water supply and developing sustainable groundwater use. SEWD surface water is used for agricultural irrigation and drinking water for the greater City of Stockton. Since 1978, the SEWD drinking water treatment plant has produced over a million acre-feet of water for urban use; enough to cover the City of Stockton's 56.5 square mile area over 25-feet deep in water. For more information, visit www.sewd.net/history

